


NOTES

1. TAPPING SADDLES FOR CONNECTIONS SHALL BE FULL BODY STAINLESS STEEL SMITH BLAIR #663 OR APPROVED EQUAL.
2. THE TAPPING SLEEVE SHALL HAVE A TEST PORT/ PLUG.
3. AFTER THE TAPPING SLEEVE HAS BEEN ASSEMBLED IT SHALL PASS THE MANUFACTURER'S RECOMMENDED TEST BEFORE THE PRESSURE CONNECTION COMMENCES.
4. TAPPING VALVE SHALL HAVE STAINLESS STEEL HARDWARE.
5. VALVE SHALL BE MUELLER OR WATEROUS.
6. STAINLESS STEEL VALVE STEM EXTENSION MAY BE REQUIRED IF STANDARD 8 FT VALVE KEY WILL NOT EXTEND 3 FT ABOVE FINISHED GRADE DURING OPERATION. USE OF VALVE STEM EXTENSION SHALL BE AT THE DISCRETION OF LCPW.

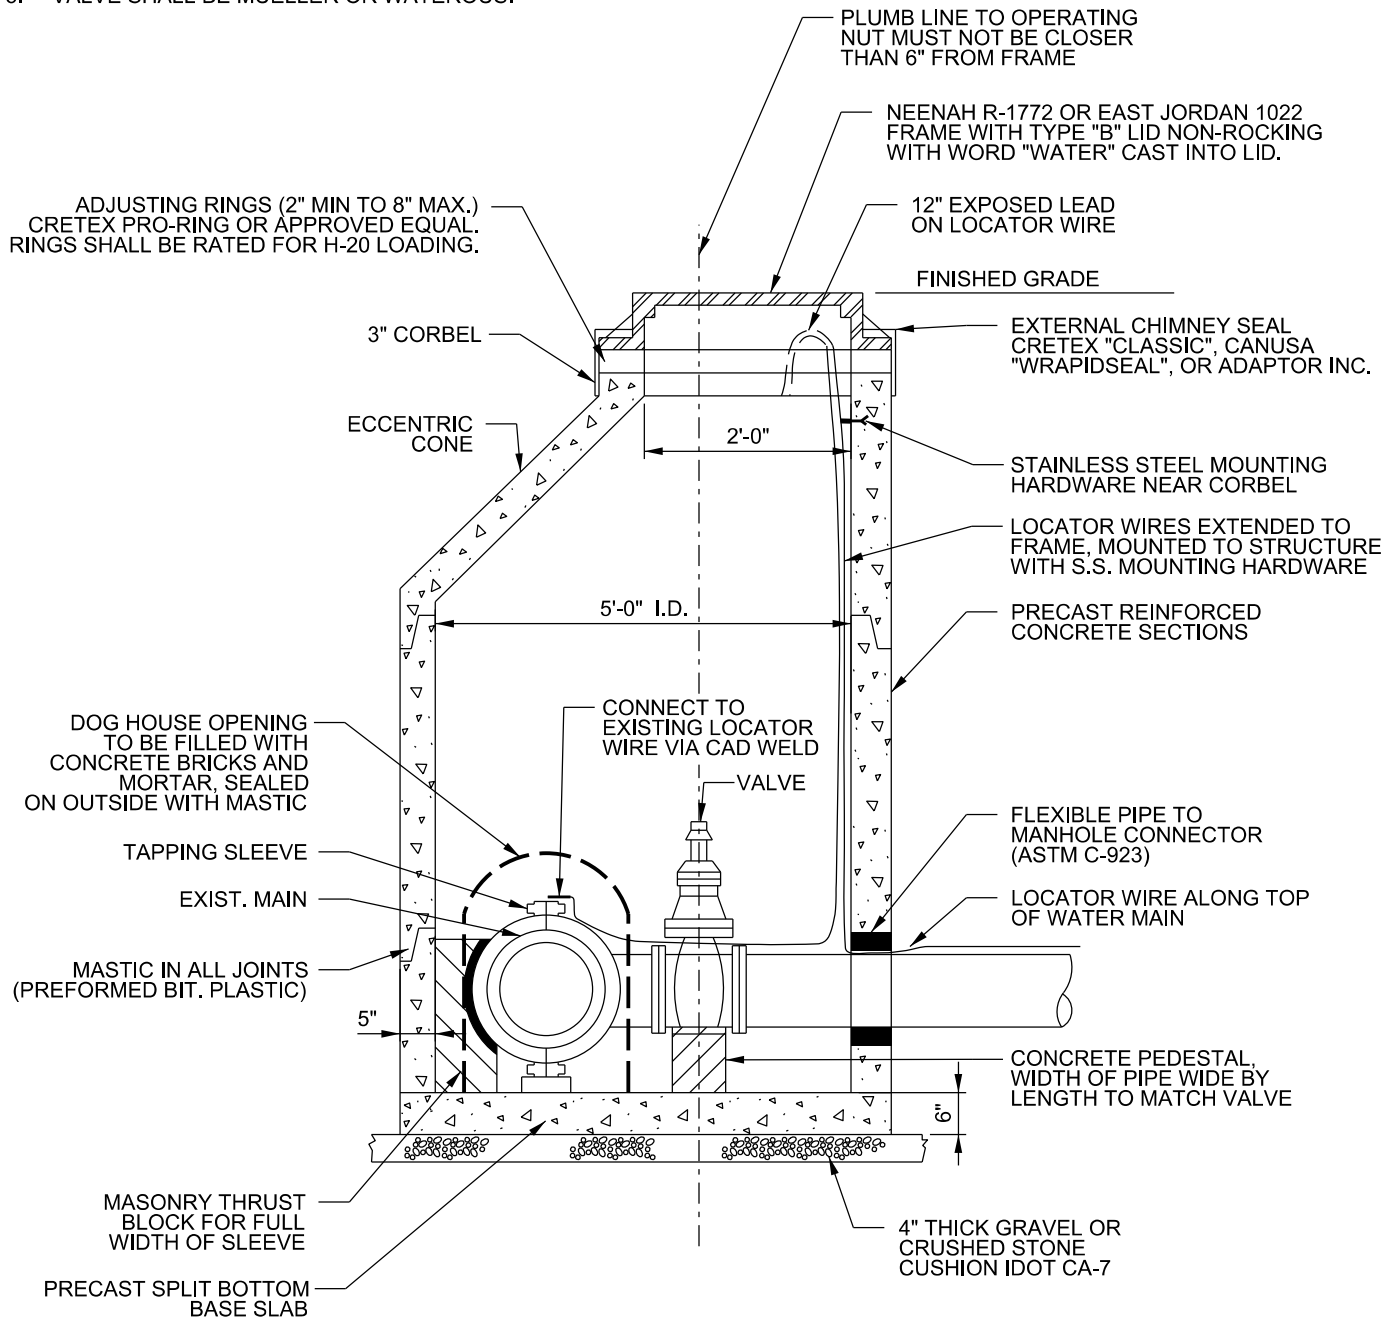

DATE: 6/26/15	ID: 4
REVISIONS	
DATE	
ENG-MAIN. UPDATE 7/24/18	
ENG-MAIN. UPDATE 9/20/18	
ENG-MAIN. UPDATE 12/14/20	