


CONCRETE WET WELL SHALL BE LINED WITH AN APPROVED BIOGENIC CORROSION RESISTANT LINER OR FABRICATED WITH AN APPROVED CONCRETE ADDITIVE.

PLAN VIEW

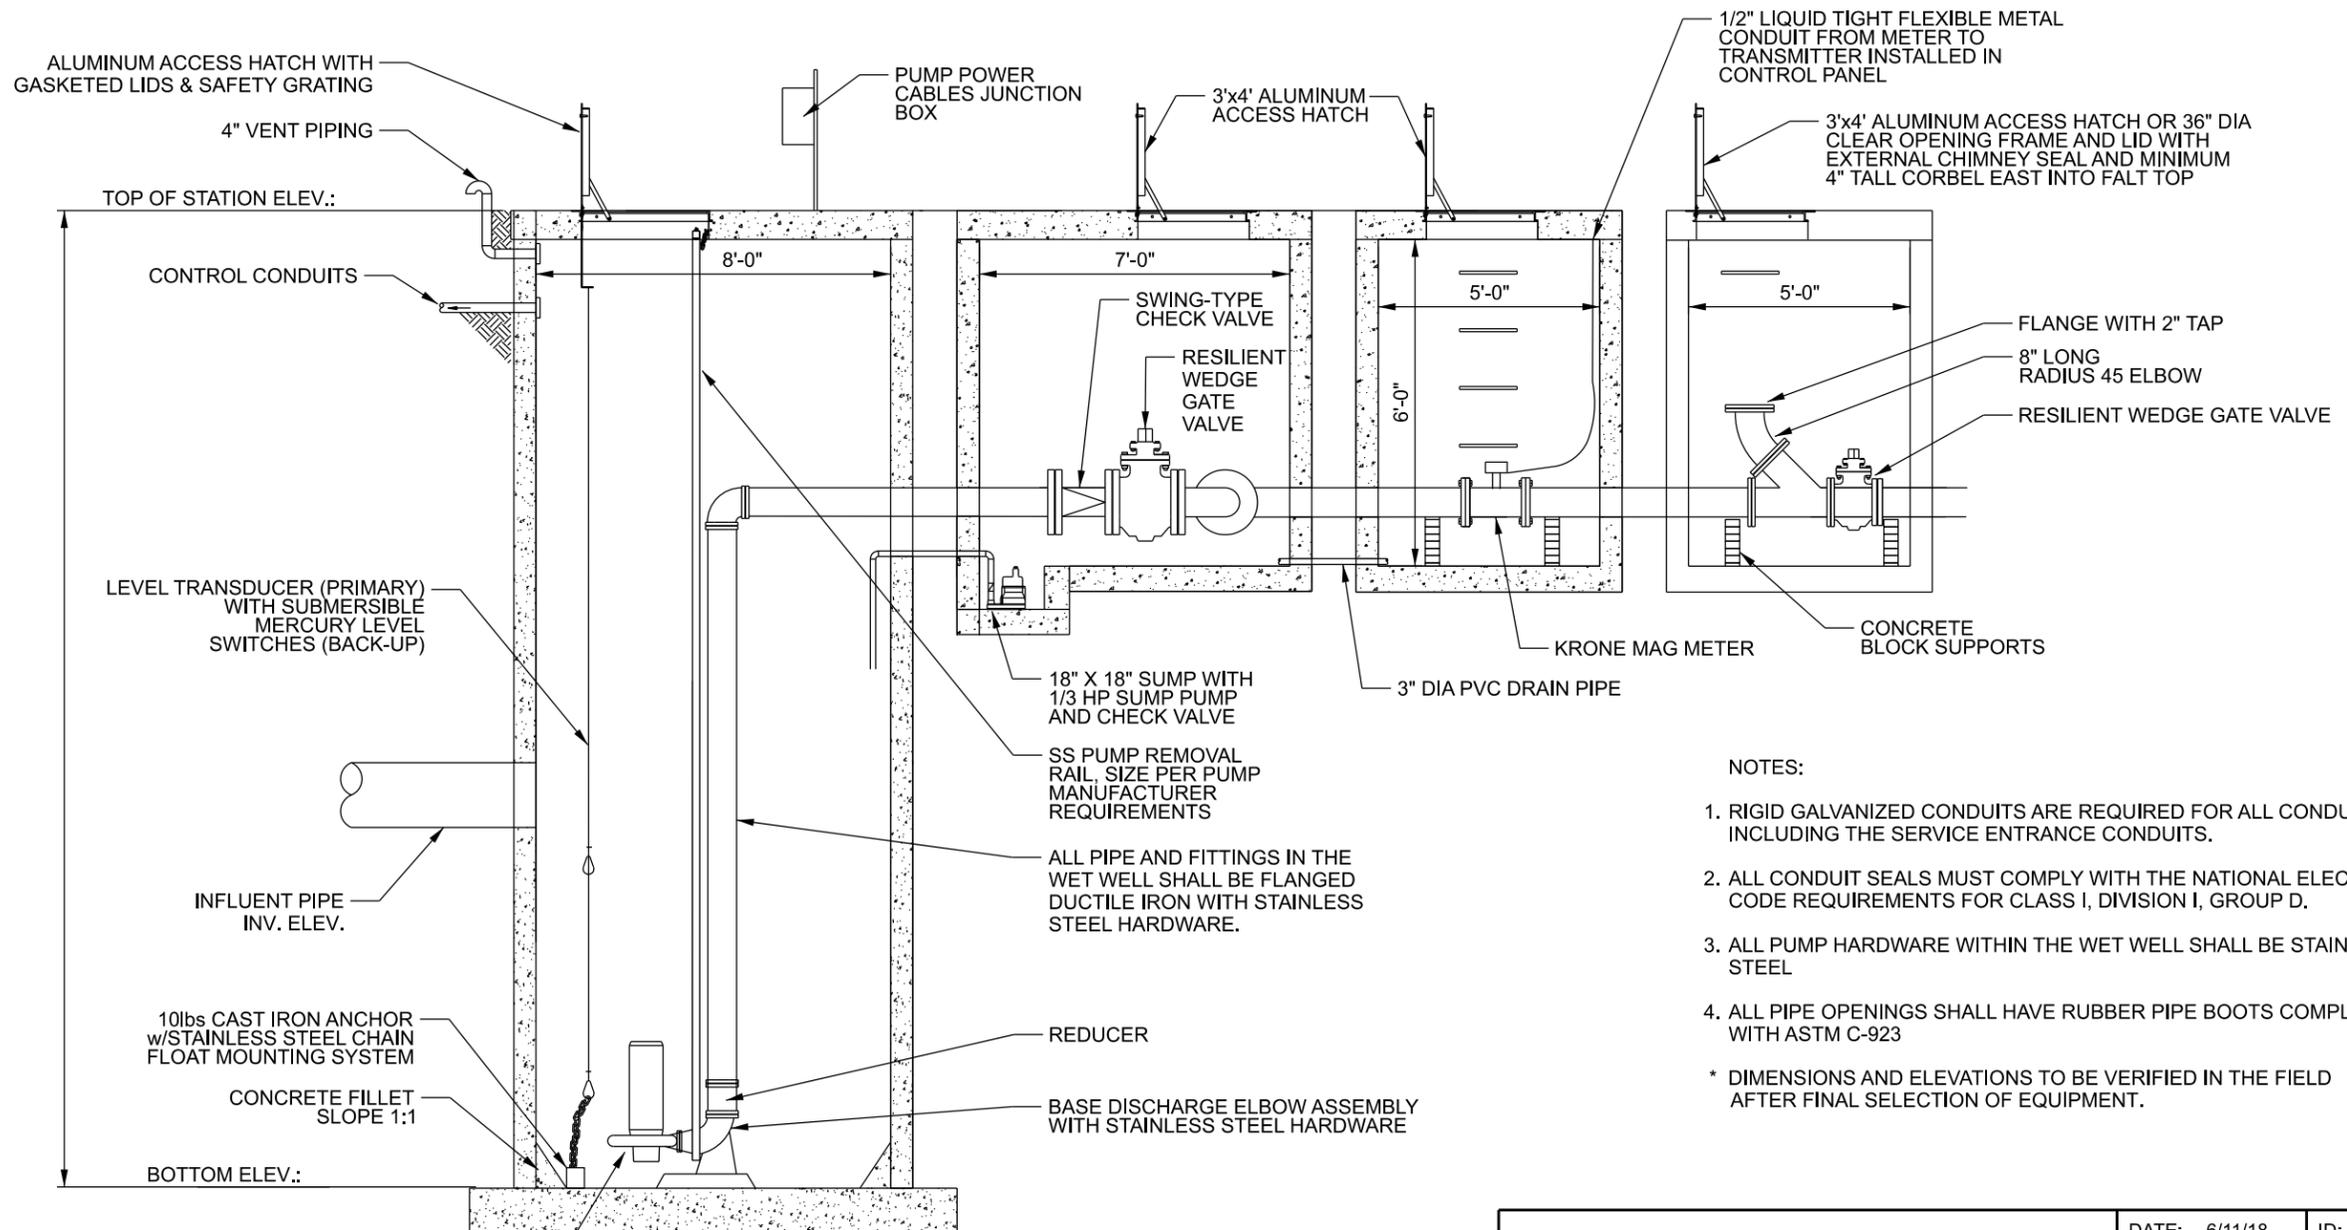

CONTROL LEVELS
 ALARM LEVEL ELEV.
 TWO PUMPS ON ELEV.
 ONE PUMPS ON ELEV.
 PUMPS OFF ELEV.

- NOTES:
1. RIGID GALVANIZED CONDUITS ARE REQUIRED FOR ALL CONDUITS, INCLUDING THE SERVICE ENTRANCE CONDUITS.
 2. ALL CONDUIT SEALS MUST COMPLY WITH THE NATIONAL ELECTRIC CODE REQUIREMENTS FOR CLASS I, DIVISION I, GROUP D.
 3. ALL PUMP HARDWARE WITHIN THE WET WELL SHALL BE STAINLESS STEEL
 4. ALL PIPE OPENINGS SHALL HAVE RUBBER PIPE BOOTS COMPLYING WITH ASTM C-923
- * DIMENSIONS AND ELEVATIONS TO BE VERIFIED IN THE FIELD AFTER FINAL SELECTION OF EQUIPMENT.

VARIABLE SPEED SUBMERSIBLE PUMP. PUMP SHALL BE CAPABLE OF OPERATING WITH A VARIABLE FREQUENCY DRIVE.

WET WELL

TYPICAL DUPLEX LIFT STATION		DATE: 6/11/18	ID: 14
		REVISIONS	DATE